


Xgard Type 4 Duct Mounting Kit Assembly Instructions

This manual refers to Crowcon product part number: C011056

The Duct Mounting Kit is designed to be used with Crowcon's Xgard Type 4 high temperature flammable gas detector for monitoring potentially hazardous gases within ventilation ducts. The duct kit is designed for direct fitment to the duct wall and is suitable for use in duct flows of up to 6 metres per second.

The duct mounting kit comprises components as shown below:

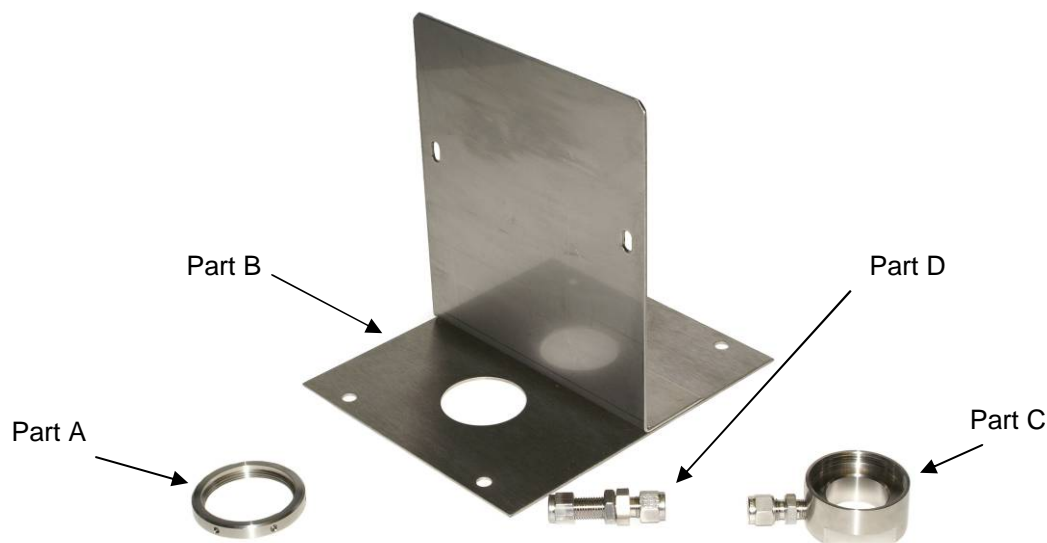

1. Screw part A fully onto the Xgard Type 4 sensor housing ensuring the un-threaded side of part A is oriented uppermost.
2. Pass the Xgard Type 4 sensor housing through the duct plate orifice (part B) and secure the Xgard junction box to the plate using M6 screws and nuts.
3. Screw part C securely to the Xgard Type 4 sensor housing from the under-side of the duct plate.
4. Fit the pipe fitting (part D) through the small hole in the duct plate and secure with the retaining nut.
5. Connect a short length of 6mm pipe between the pipe fitting (part D) and part C to enable test gas to be applied to the detector whilst the duct plate is in-situ.

A correctly assembled part should appear as shown on the following page.

The plate must be installed on the duct wall with the sensor protruding into the duct (see Figure C). To avoid the adverse effects of turbulence, the plate should be installed in the centre of a straight section of duct which has a length of at least six times its width.

Testing and Commissioning

Calibrate the detector according to its instructions. Testing the operation of the ASU can be performed by introducing gas into the duct system.

Warning: it is essential to ensure that procedures are in place to prevent people and/or equipment being affected by any test gas introduced into the ventilation system.



Figure A: Side View



Figure B: Front View



Figure C: Bottom (Duct-Side) View



A HALMA COMPANY

© Crowcon Detection Instruments Ltd 2015

UK Office
 Crowcon Detection Instruments
 Ltd
 172 Brook Drive,
 Milton Park,
 Abingdon
 Oxfordshire OX14 4SD
 Tel: +44 (0)1235 557700
 Fax: +44 (0)1235 557749
 Email: sales@crowcon.com
 Website: www.crowcon.com

USA Office
 Crowcon Detection
 Instruments Ltd
 1455 Jamike Ave, Suite 100
 Erlanger
 Kentucky 41018
 Tel: +1 859 957 1039 or
 1 800 527 6926
 Fax: +1 859 957 1044
 Email: salesusa@crowcon.com
 Website: www.crowcon.com

Netherlands Office
 Crowcon Detection Instruments Ltd
 Vlambloem 129
 3068JG
 Rotterdam
 Netherlands
 Tel: +31 10 421 1232
 Fax: +31 10 421 0542
 Email: eu@crowcon.com
 Website: www.crowcon.com

Singapore Office
 Crowcon Detection
 Instruments Ltd
 Block 194 Pandan Loop
 ~06-20 Pantech Industrial Complex
 Singapore 128383
 Tel: +65 6745 2936
 Fax: +65 6745 0467
 Email: sales@crowcon.com.sg
 Website: www.crowcon.com

China Office
 Crowcon Detection Instruments Ltd
 (Beijing)
 Unit 316, Area 1, Tower B, Chuangxin
 Building
 12 Hongda North Road, Beijing
 Economic Technological Development
 Area
 Beijing, China 100176
 Tel: +86 10 6787 0335
 Fax: +86 10 6787 4879
 Email: saleschina@crowcon.cn
 Website: www.crowcon.com

Crowcon reserves the right to change the design or specification of this product without notice.